

For Non-Health Hazard Applications

Job Name _____

Contractor _____

Job Location _____

Approval _____

Engineer _____

Contractor's P.O. No. _____

Approval _____

Representative _____

Series 774DCDA

Double Check Detector Assemblies

Sizes 2½" – 12" (65 – 300mm)



Series 774DCDA Double Check Detector Assemblies are designed for use in accordance with water utility non-health hazard containment requirements. It is mandatory to prevent the reverse flow of fire protection system substances, i.e., glycerin wetting agents, stagnant water and water of non-potable quality from being pumped or siphoned into the potable water supply.

Features

- Patented torsion spring check valve provides low head loss
- Short lay length is ideally suited for retrofit installations
- Stainless steel body is half the weight of competitive designs reducing installation and shipping cost
- Stainless steel construction provides long term corrosion protection and maximum strength
- Single top access cover with two-bolt grooved style coupling for ease of maintenance
- Thermoplastic and stainless steel check valves for trouble-free operation
- No special tools required for servicing
- Compact construction allows for smaller vaults and enclosures
- Furnished with 5/8" x 3/4" (16x19mm) bronze meter (gpm or cfm)
- Detects underground leaks and unauthorized water use
- May be installed horizontal or vertical "flow up" position

Specifications

A Double Check Detector Assembly shall be installed on fire protection systems when connected to a potable water supply. Degree of hazard present is determined by the local authority having jurisdiction. The assembly shall consist of two positive seating check valves located between two resilient seated shutoffs with a hydraulically balanced bypass line and four test cocks. The main valve body shall be manufactured from 300 Series stainless steel to provide corrosion resistance. The check valves shall be of thermoplastic construction with stainless steel hinge pins, cam arm and cam bearing. The check valves shall utilize a single torsion spring design to minimize pressure drop through the assembly. The check valves shall be modular and shall seal to the main valve body by the use of an O-ring. There shall be no brass or bronze parts used within the check valve assembly. The check valve seats shall be of molded thermoplastic construction. The use of seat screws as a retention method is prohibited. All internal parts shall be accessible through a single cover on the valve assembly. The valve cover shall be held in place through the use of a single grooved style two-bolt coupling. The bypass line shall be hydraulically sized to accurately measure low flow. The bypass line shall consist of a meter, a small diameter double check assembly with test cocks and isolation valves. The bypass line double check valve shall have a single access cover, two independently operating modular poppet check valves, and top mounted test cocks. The assembly shall be a Watts Regulator Company Series 774DCDA.

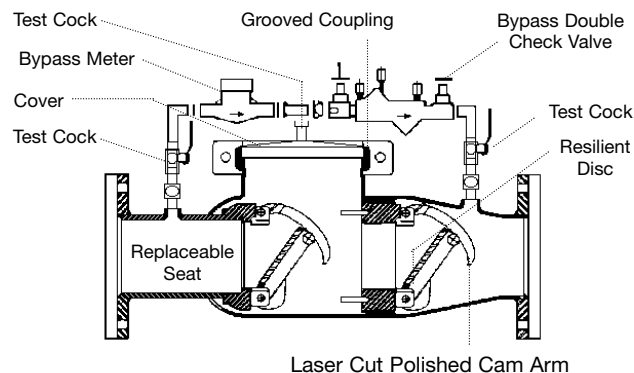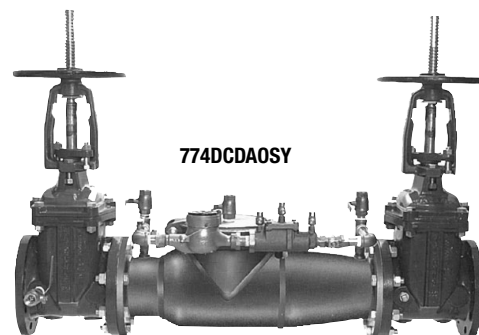

Available Models

Suffix:

LF – without shutoff valves

OSY – UL/FM outside stem and yoke resilient seated gate valves

*OSY FxG – flanged inlet gate connection and grooved outlet gate connection

*OSY GxF – grooved inlet gate connection and flanged outlet gate connection

*OSY GxG – grooved inlet gate connection and grooved outlet gate connection

CFM – cubic feet per minute meter

GPM – gallons per minute meter

Available with grooved NRS gate valves - consult factory*

Post indicator plate and operating nut available - consult factory*

*Consult factory for dimensions

Now Available WattsBox Insulated Enclosures.

For more information, send for literature ES-WB.

**IMPORTANT: INQUIRE WITH GOVERNING AUTHORITIES
FOR LOCAL INSTALLATION REQUIREMENTS**

WATTS®

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

Materials




All internal metal parts: 300 Series stainless steel, Main valve body: 300 Series stainless steel, Check assembly: Noryl® Flange dimensions in accordance with AWWA Class D.

Pressure - Temperature

Temperature Range: 33°F – 110°F (0.5°C – 43°C) continuous
Pressure Range: 175psi (12.1 bar)

Capacity

Flow curves as tested by Underwriters Laboratory per UL 1469, 1996 * Rated flow **UL Tested

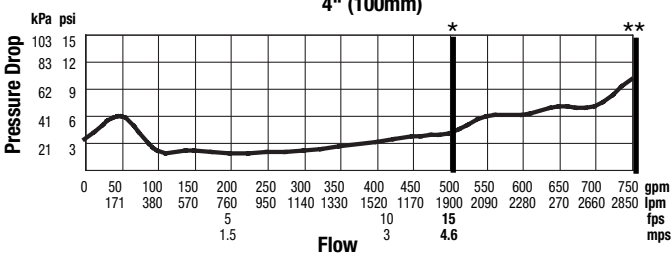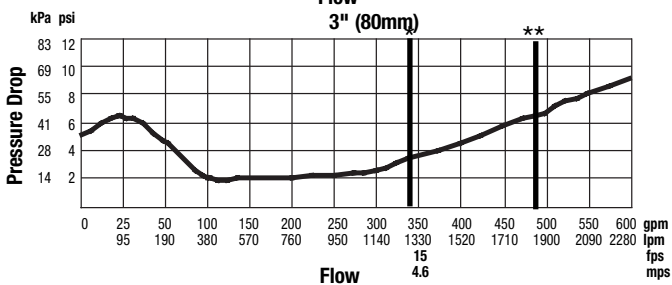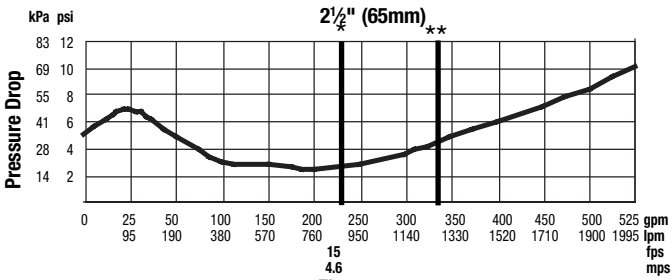

Standards

AWWA C510-97, CSA B64.5

Approvals







(2 1/2" - 10" only)
(65 - 250mm)



(OSY only)

For 12" approvals consult factory.

**UL Tested

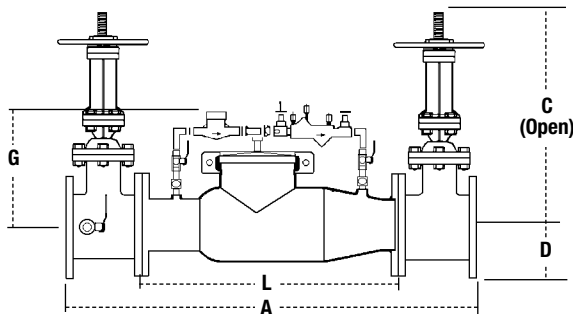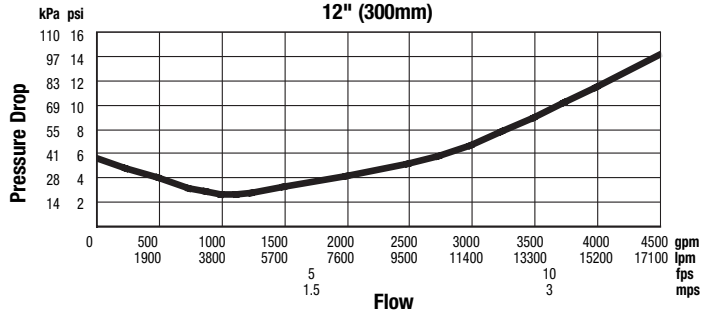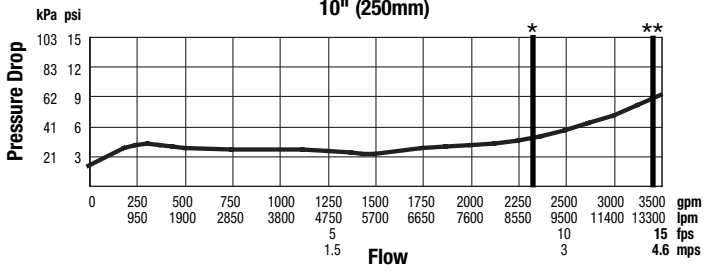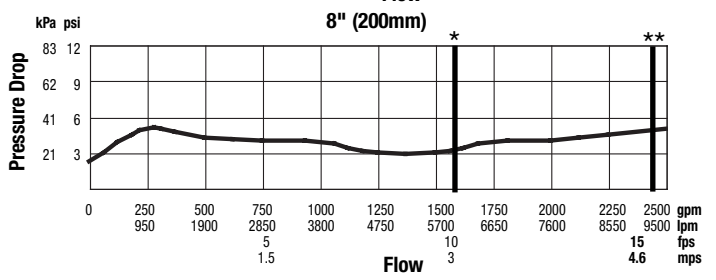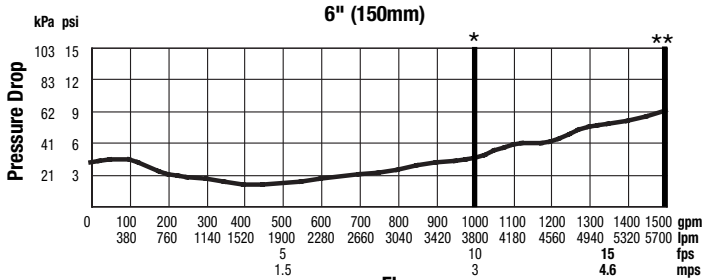

Noryl is a registered trademark of General Electric Company

SIZE (DN)		DIMENSIONS								WEIGHT							
in.	mm	A		C (OSY)		D		G		L		P		w/Gates		w/o Gates	
		in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kgs.	lbs.	kgs.
2 1/2	65	38	965	16 3/8	416	3 1/2	89	10	250	22	559	12 1/2	318	155	70	68	31
3	80	38	965	18 7/8	479	3 3/4	95	10	250	22	559	13	330	230	104	70	32
4	100	40	1016	22 3/4	578	4 1/2	114	10	250	22	559	14 1/2	368	240	109	73	33
6	150	48 1/2	1232	30 1/8	765	5 1/2	140	15	381	27 1/2	699	15 1/2	394	390	177	120	54
8	200	52 1/2	1334	37 3/4	959	6 3/4	171	15	381	29 1/2	749	18 1/4	464	572	259	180	82
10	250	55 1/2	1410	45 3/4	1162	8	200	15	381	29 1/2	749	19 1/2	495	774	351	190	86
12	300	57 1/2	1461	53 1/8	1349	9 1/2	241	15	381	29 1/2	749	21	533	1044	474	220	100



Backflow Prevention Products

ES-774DCDA 0645



USA: 815 Chestnut St., No. Andover, MA 01845-6098; www.watts.com

Canada: 5435 North Service Rd., Burlington, ONT. L7L 5H7; www.wattscanada.ca

© Watts Regulator Company, 2006